

Submittal Data: TVRF-OC96KHP/220V	96,000 BTU/h VRF Condenser Heat Pump
Job Name	Location Date
Purchaser	Engineer
Submitted To	For Reference Approval Construction
Unit Designation	Schedule No.
GENERAL FEATURES -Sensorless DC Inverter Fan Motor	TOSOT

- -Compact Design
- -Non-Polar CAN Technology for Improved Communication Efficiency
- -Increased Energy Savings through Higher Efficiency
- -Fast Start-up in Heating Mode
- -Patented 2 Stage Oil Separation Technology & Improved Oil Return Control Technology
- -Smaller Impact on Power Grid
- -Allows for Flexible Installation

_								
- 13	$\overline{}$		^	m	-	-	r	\sim
_	_	_		m	а		L	_

US Ton 8

Cooling

Rated Capacity 92,000 BTU/h

26.9 kW

EER 12.82

Heating

Rated Capacity 103,000 BTU/h

30 kW

COP 13.83

10.00

Capacity Modulation Range 10 ~ 100 %

Operating Range

Cooling (Min-Max) 23~126°F (-5~52°C)

Heating (Min-Max) -4~75°F (-20~24°C)

Electrical & Power Supply

Normal Operational Voltage 208/230 V, 3 Phase, 60 Hz

MCA 45 A

MOCP/Breaker Size 80 A



Unit Data

_	_	

Type x Qty Propeller x 2
Output Power 750 W

Airflow 8239 CFM

14000 m³/h

ESP 82 Pa

Compressor

Type x Qty Inverter Scroll x 2

Sound Pressure Level 63 dB(A)

Indoor Units

Max Qty 23 Total Capacity 50 - 135 %

Dimensions & Weights

Unit Dimensions (WxHxD) 52.76×63.19×30.12-in Weight (Net/Gross) 794/827 LBS

Refrigerant and Piping


Refrigerant Type R410A 345.7 oz Refrigerant Charge Gas Pipe Size (OD) 1-in Liquid Pipe Size (OD) 1/2-in Oil Pipe Size (OD) 3/8-in Connection Method Flared MAX Refrigerant Pipe Length 541-ft MIN Refrigerant Pipe Length 10-ft









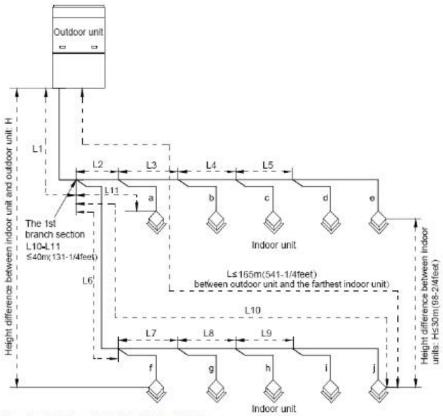


L10: Length from the first branch to the farthest IDU; L11: Length from the first branch to the nearest IDU; Equivalent length of branch of IDU is 0.5m


R410A Refrigerant System Total length (actual length) of fitting pipe		Allowable Value m(feet)	Fitting Pipe L1+L2+L3+L4++L9+a+b++i+j	
		1000(3280-3/4)		
Length of farthest Actual length		165(541-1/4)	14-15-17-18-18-1	
fitting pipe m(feet)	Equivalent length	190(623-1/4)	L1+L6+L7+L8+L9+j	
first branch of IDU to th	e pipe length from the ne farthest IDU and the st branch of IDU to the st IDU	40(131-1/4)	L10-L11	
Equivalent length from the first branch to the furthest piping (1)		40(131-1/4)	L6+L7+L8+L9+j	
Height difference	Outdoor unit at upper	50(164)	¥ <u>2—</u> 28	
between outdoor unit and indoor unit	Outdoor unit at lower	90(295-1/4)	8 7 - 1 2	
Height difference between indoor units		30(98-2/4)	\$ <u></u> \$	
Maximum length of Main pipe(2)		90(295-1/4)	L1	
From IDU to its nearest branch (3)		10(32-3/4)	a,b,c,d,e,f,g,h,i,j	

Notices:

- (1) Normally, the pipe length from the first branch of IDU to the farthest IDU is 40m(131-1/4feet). Under the following conditions, the length can reach 90m(295-1/4feet).
- 1) Actual length of pipe in total: L1+L2x2+L3x2+L4x2+...+L9x2+a+b+...+i+j≤1000m(3280- 3/4feet).
- Length between each IDU and its nearest branch a, b, c, d, e, f, g, h, i, j≤40m(131-1/4feet).
- 3) Difference between the pipe length from the first branch of IDU to the farthest IDU and the pipe length from the first branch of IDU to the nearest IDU: L10-L11≤40m(131-1/4feet).
- (2) When the maximum length of the main pipe from ODU to the first branch of IDU is≥90m(295- 1/4feet), then adjust the pipe size of the gas pipe and liquid pipe of main pipe according to the following table.

DIMENSIONAL SPECIFICATIONS

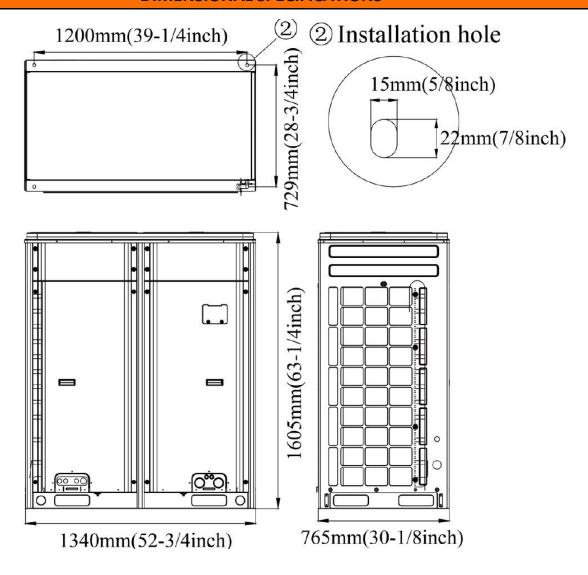

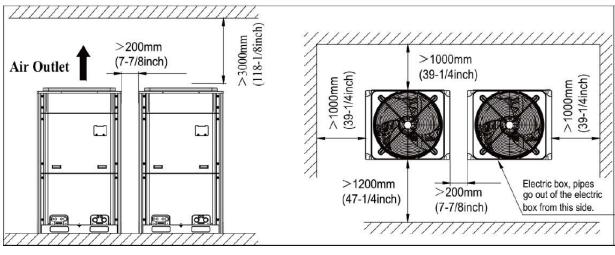

Notes:

- ${\bf 1.}~Recommended~Interconnecting~Cable~Type~Stranded~Bare~Copper~Conductors~THHN~600V~Wire$
- ${\bf 2.\ Power\ wiring\ cable\ size\ must\ comply\ with\ applicable\ national\ and\ local\ codes.}$
- 3. Test conditions are based on AHRI 210/240.